


**PC CHAMBER FOR SCOUR
VALVE DEPTH 1m TO 1.5m**



**PC CHAMBER FOR SCOUR
VALVE DEPTH LESS 1m**

- NOTES:-**
1. ALL DIMENSIONS ARE IN MILLIMETRE UNLESS OTHERWISE STATED.
 2. ALL STEELWORK TO BE PAINTED WITH 2 COATS OF APPROVED ANTI CORROSIVE PAINT/EPOXY 325 MICRO DFT.
 3. LEAN CONCRETE SHALL BE OF GRADE 15/20.
 4. ALL VALVES SHALL BE OF DUCTILE IRON GRADE $\frac{500}{7}$ PN 16 TO SPAN APPROVAL.
 5. FOR SLUICE VALVE CHAMBER LOCATED WITHIN THE ROAD SHALL USE RC COVER CHAMBER TO DETAILS.

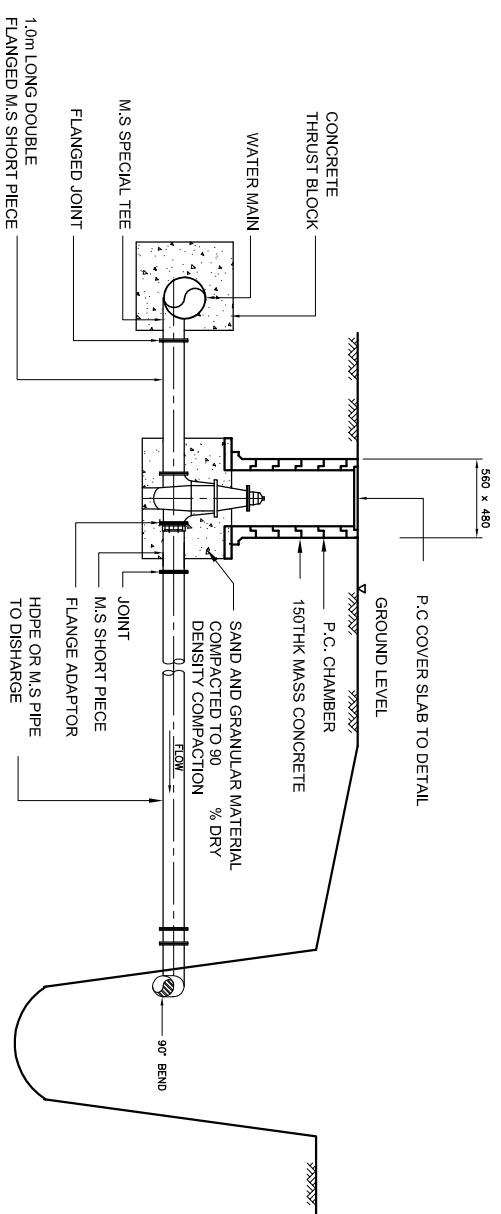

SURJAHANUVA PERKHIDMATAN AIR NEGARA
Araa Berohi & Araa Satu
Pinto Avenue, Blok 3510
Seri Kembangan, Selangor
63000 Cyberjaya
Selangor Darul Ehsan, Malaysia

PREPARED BY :
MINCONSULT SDN. BHD.
No. 6, JALAN 514/223,
SERI KEMBANGAN, BLOK 3510,
SRI KEMBANGAN, SERI KEMBANGAN,
MULAYSA
m i n c o TEL: 03-79972575 / 79547373
FAX 03-79547575 / 79547373

DRAWING TITLE:

TYPICAL DETAILS OF SLUICE VALVE AND
SCOUR VALVE CHAMBER
SHEET 2 OF 2

DRAWING NO: SPAN/WSS/STD/F/003