


FUTURE STICKER TO INDICATE RPU CODE. (i.e. REZAB PAIP UTAMA 001 etc) ACTUAL TEXTS MAY CHANGE ACCORDING TO FUTURE STANDARD

FUTURE STICKER TO INDICATE CHAINAGE DISTANCE FROM POINT OF ORIGIN (RESERVOIR) FOR EVERY 250m, i.e. 250m, 500m, etc. IN CASE PLACING POST AT 250m INTERVAL IS NOT PRACTICAL, USE ACTUAL DISTANCE FROM POINT OF ORIGIN i.e. CH 260m, CH, 510m etc. ACTUAL TEXTS MAY CHANGE ACCORDING TO FUTURE STANDARD


OPTION 1

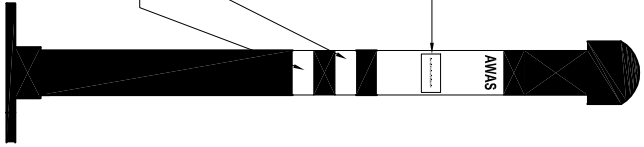


FRONT ELEVATION

END ELEVATION


SECTION SHOWING REINFORCEMENT

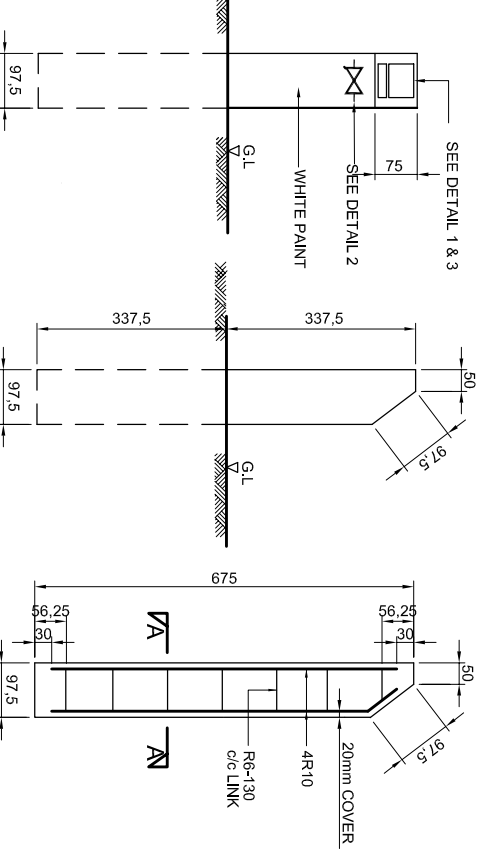


SECTION A-A



DETAIL 1




DETAIL 2



DETAIL 3

ALL LETTERS ARE TO BE COUNTERSUNK BY 6mm AND PAINTED IN RED CLASS AND SIZE OF PIPE TO BE STENCILED AS REQUIRED (SEE DETAIL 3)

WATER DISTRIBUTION LICENSEE/ SERVICE LICENSEE LOGO
DIAMETER OF PIPE IN mm
TYPE OF PIPE
(1) M/S FOR MILD STEEL PIPE

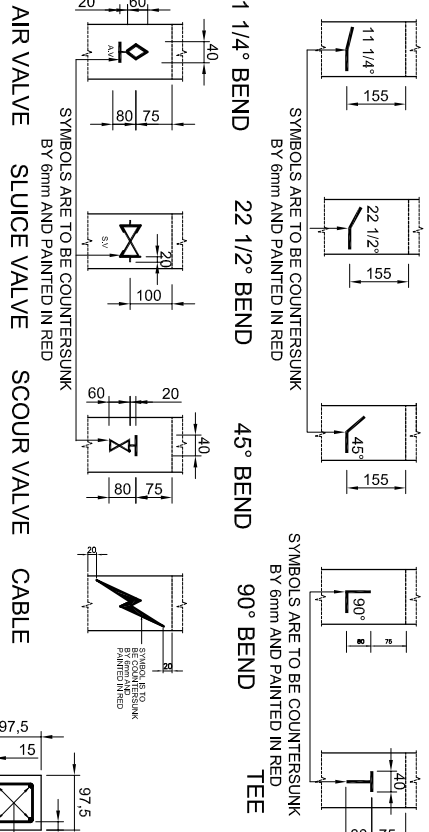

AIR VALVE SLUICE VALVE SCOUR VALVE CABLE

DETAIL 2

SECTION A-A



SURUHANJAYA PERKHIDMATAN AIR NEGARA
No. 6, JALAN 51/4/223,
46100 PETAJING JAYA,
SELANGOR DARUL EHSAN, MALAYSIA
Prime Avenue, Block 3510
53000 Cyberjaya
Sistem Pengirip
Sistem Selat Ehsan, Malaysia

PREPARED BY :
MINCONSULT SDN. BHD.
No. 6, JALAN 51/4/223,
46100 PETAJING JAYA,
SELANGOR DARUL EHSAN, MALAYSIA
m i n c o s d n
TEL: 03-7957257 / 79542373
FAX: 03-79571513

DRAWING TITLE:
DETAILS OF STANDARD
MARKER POST

DRAWING NO:
SPANWS/STD/IF/024

NOTES:-
1. ALL DIMENSIONS ARE IN MILLIMETRE UNLESS OTHERWISE STATED.
2. STICKER SHALL BE OF 3M SCOTCH LITE REFLECTIVE STICKER.