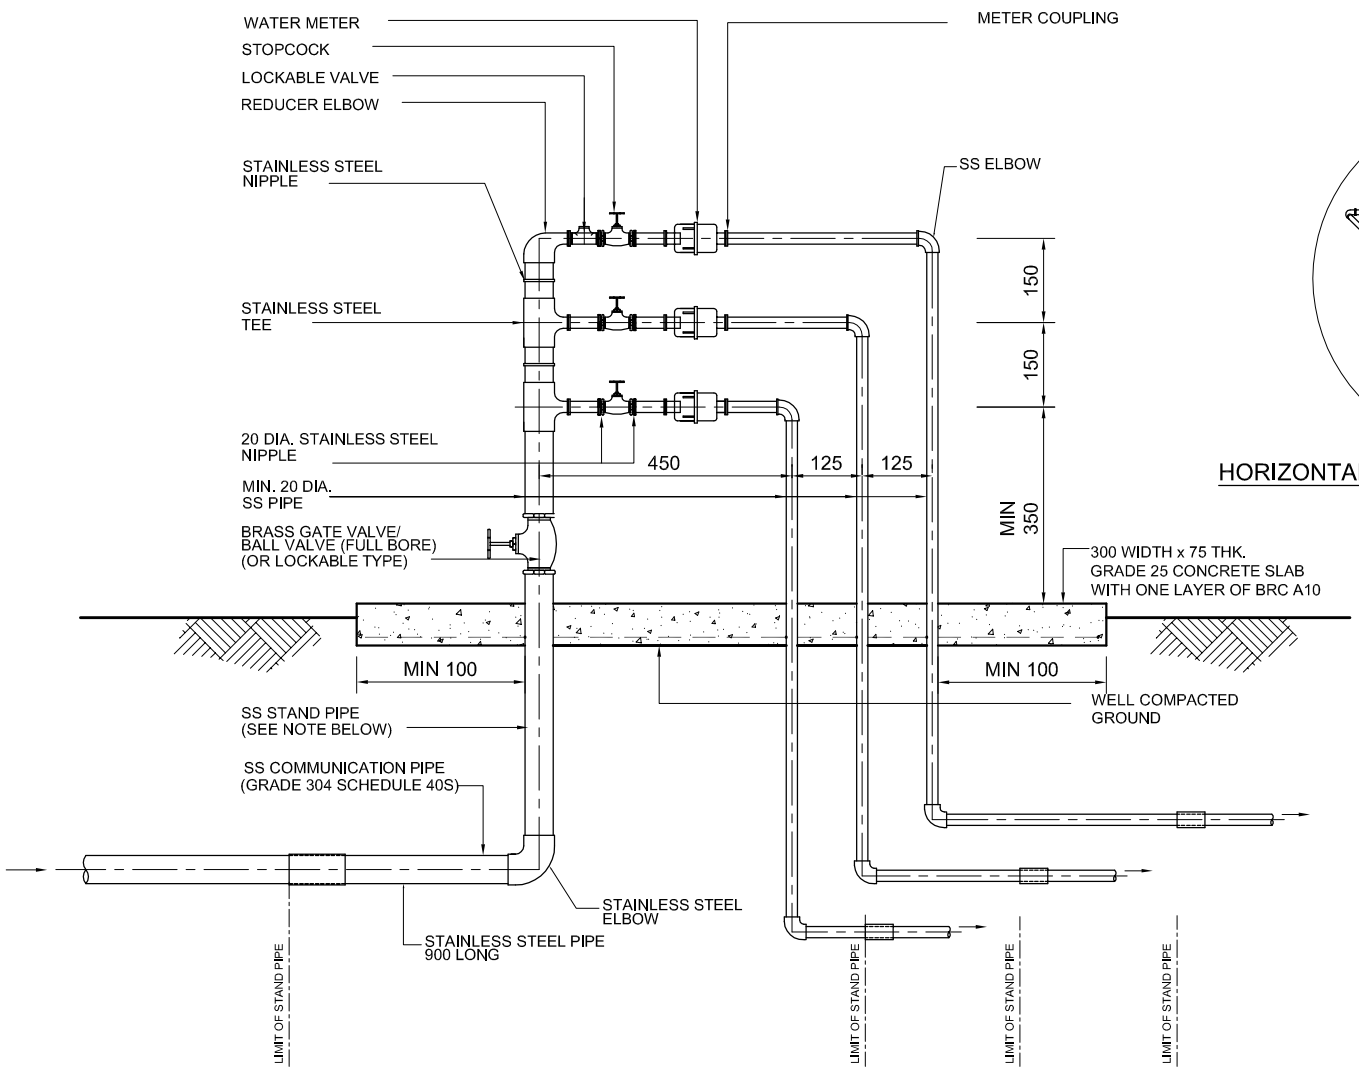

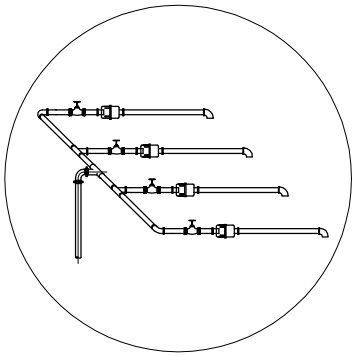

HORIZONTAL INSTALLATION (ALTERNATIVE)

NOTE :-
1. SS STAND PIPE SHALL BE :
   a.) 25 DIA. FOR 2 Nos. OF METERS OR
   b.) 50 DIA. FOR 3 OR MORE Nos. OF METERS

TYPICAL DETAILS OF STAINLESS STEEL METER STAND INSTALLATION FOR MULTI METER CONNECTION

NOTES:
1. ALL DIMENSIONS ARE IN MILLIMETRE AND LEVELS ARE IN METRE UNLESS OTHERWISE STATED.
2. ACTUAL LENGTH OF COMMUNICATION PIPE SHALL BE DETERMINED ON SITE.
3. ALL CONCRETE TO BE GRADE 25 UNLESS OTHERWISE STATED.
4. ALL STAINLESS STEEL PIPES SHALL BE OF GRADE 304 TO SCHEDULES 40S.
5. ALL STAINLESS STEEL PIPES SHALL BE SOURCED FROM SUPPLIERS/ MANUFACTURERS APPROVED BY SPAN.
6. ACTION WILL BE TAKEN AGAINST PLUMBER/CONTRACTOR/CONSULTANT/ DEVELOPERS FOUND USING UNAPPROVED MATERIALS.

SPAN

SURUHANJAYA PERKHIDMATAN AIR NEGARA

Aras Bawah & Aras Satu
Prima Avenue, Blok 3510
Jalan Teknokrat 6,
63000 Cyberjaya
Selangor Darul Ehsan, Malaysia

PREPARED BY :

MINCONSULT SDN. BHD.
No. 6, JALAN 51A/223,
46100 PETALING JAYA,
SELANGOR DARUL EHSAN, MALAYSIA.
TEL. 03-79575757
FAX 03-79547575 / 79547373

DRAWING TITLE :

METER STAND FOR MULTI METER CONNECTION

DRAWING NO:

SPAN/WS/STD/032

[Infrastructure Div] 3414 C:\SPAN\final drawings\ WSSTDF032.dwg Wed, 02 Nov 2011 - 3:44pm